




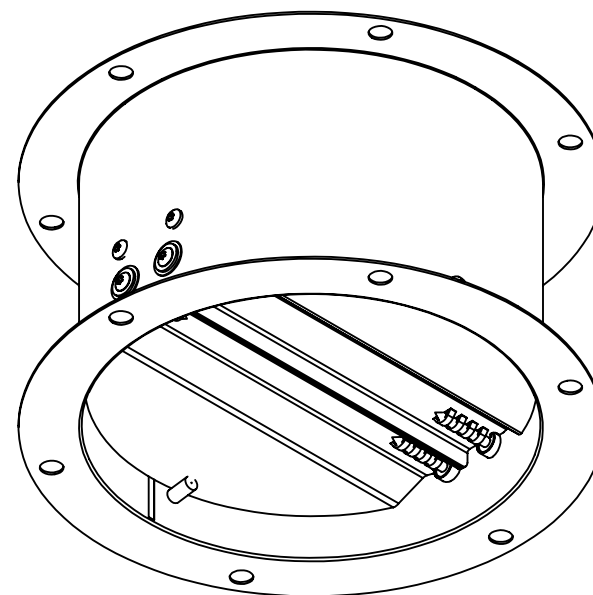

Luft / Air

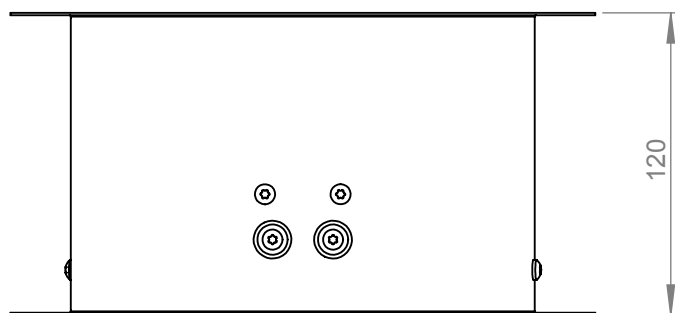

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

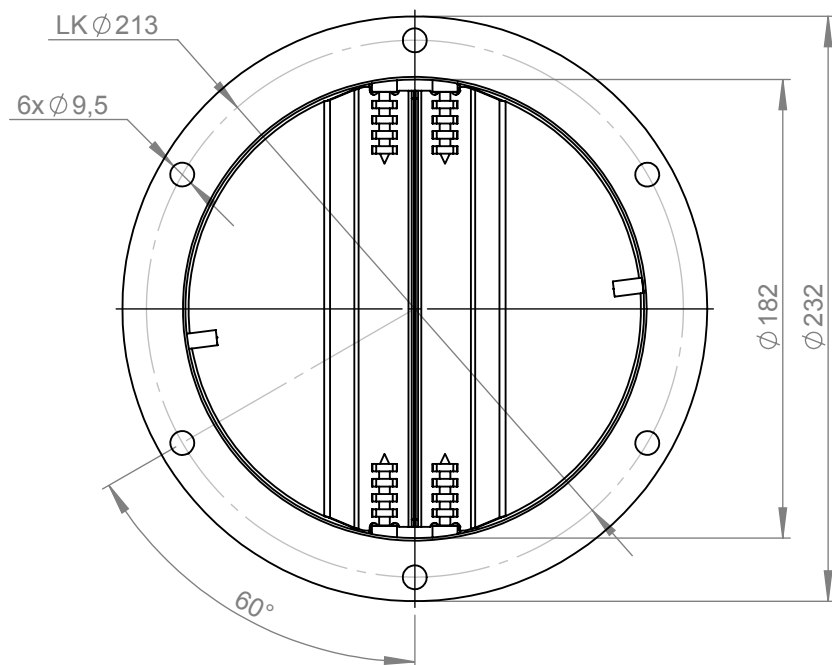

1:3 A4 mm

Protection Mark according to ISO16016 General tolerances DIN ISO 2768-c

Created h.sachsenheimer 17.07.2019

Drawn h.sachsenheimer 17.07.2019

Released h.sachsenheimer 12.12.2019

Disabled

DVK18010

153000 00